



## CONDITION A-FIRE CONNECTION WITHIN PUBLIC RIGHT OF WAY

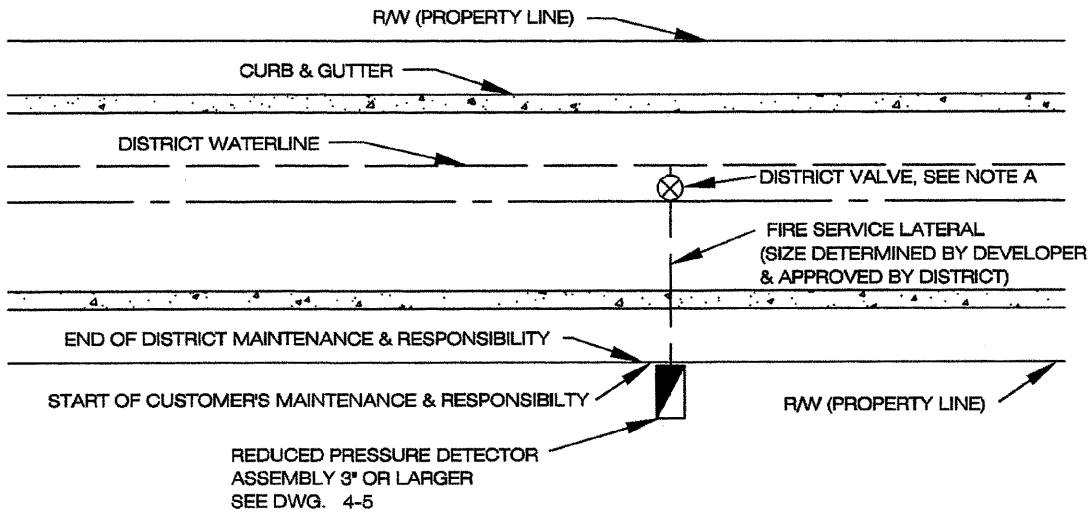

## CONDITION B-FIRE CONNECTION WITHIN DISTRICT EASEMENT

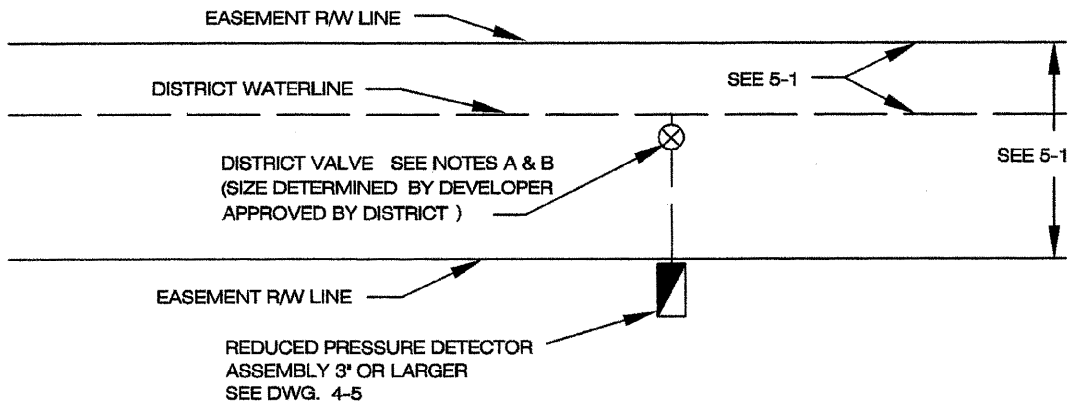

### NOTE

- A DISTRICT VALVE TO BE OPERATED SOLELY BY DISTRICT. CUSTOMER TO NOTIFY DISTRICT TO CLOSE VALVE WHEN REQUIRED FOR MAINTENANCE OF CUSTOMER'S SYSTEM.
- B DISTRICT MAINTENANCE AND RESPONSIBILITY TERMINATES AT DOWNSTREAM SIDE OF VALVE AND CUSTOMER'S MAINTENANCE AND RESPONSIBILITY BEGINS.
- C DISTRICT WILL INSPECT UNDERGROUND INSTALLATION OF ALL FIRE CONNECTIONS BETWEEN DISTRICT GATE VALVE AND RPDC ASSEMBLY.
- D MATERIALS USED UP TO AND INCLUDING THE RPDC ASSEMBLY ARE TO MEET DISTRICT SPECIFICATIONS.

REVISIONS	APPROVED	DATE	VISTA IRRIGATION DISTRICT	PATH: (TOM) H:\STDDWGS\4-4.DWG
			<b>FIRE SERVICE CONNECTIONS</b>	<i>John A. Amodeo</i> (2/2/97)
				JOHN AMODEO                      DATE R. C. E. 31161
				STANDARD DRAWING <b>4-4</b>
ACAD		6/96		