



NOTE: SILVER SOLDER JOINTS REQUIRED

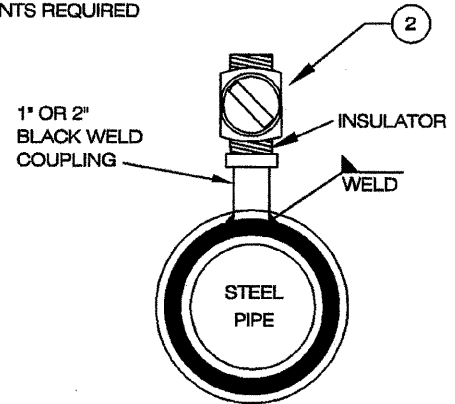

1' MIN. RADIUS (1" PIPE)
90° ELL. (2" PIPE)

SLOPE UPWARD MIN. 2%

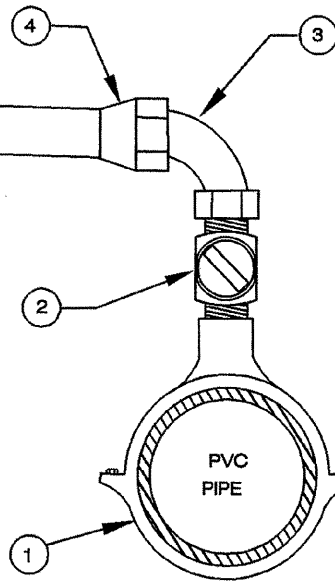

- 1 FULL CIRCLE BODY CLAMP FOR PVC
- 2 BRONZE CORPORATION STOP
- 3 90° BRASS STREET ELL.
- 4 PIPE TO TUBING ADAPTOR
- 5 COPPER TUBING
- 6 BALL VALVE
- 7 BRASS PLUG
- 8 METER BOX (SEE STD. DWG. 1-3 FOR LOCATION). METER BOX LOCATED IN TRAVELED WAYS, PAVED AREAS, AND SIDEWALKS SHALL BE CONCRETE. ALL OTHERS SHALL BE PLASTIC.

NOTE: 1. CATHODIC PROTECTION REQUIRED PER STD. DWG. 8-14
2. FITTINGS SHALL BE FLARED, END CONNECTIONS FOR 1" COPPER AND SWEAT BY THREADED FOR 2" COPPER.

LEGEND ON PLANS

REVISIONS	APPROVED	DATE	VISTA IRRIGATION DISTRICT	PATH: (TOM) H:\STDDWGS2-1.DWG
			1" AND 2" MANUAL AIR RELEASES (TYPE A)	<i>John A. Amodeo</i> 12/2/97 JOHN AMODEO R. C. E. 31161
				DATE
ACAD		6/96		STANDARD DRAWING 2-1